

Application

Designed for installation on potable water lines to protect against both backsiphonage and backpressure of contaminated water into the potable water supply. Assembly shall provide protection where a potential health hazard exists. The Model 475 is for applications requiring vertical flow up and vertical flow down. The Model 475V is for applications requiring vertical flow up. Ideal for use where lead-free valves are required.

Standards Compliance

- ASSE® Listed 1013
 - AWWA Compliant C511 (with gates only), and C550
 - CSA® Certified (4" thru 8")
 - IAPMO® Listed
 - UL® Classified
 - C-UL® Classified
 - FM® Approved
 - NYC MEA 468-99-M VOL 4
 - Approved by the Foundation for Cross Connection Control and Hydraulic Research at the University of Southern California (4"-10" gates, 4"-8" with butterfly)
 - NSF® Listed-Standard 61, Annex G*
- (*0.25% MAX. WEIGHTED AVERAGE LEAD CONTENT)

Materials

Main valve body	Ductile Iron ASTM A 536 Grade 4
Access covers	Ductile Iron ASTM A 536 Grade 4
Coatings	FDA Approved fusion epoxy finish
Internals	Stainless steel, 300 Series
	NORYL™, NSF Listed
Fasteners	Stainless Steel, 300 Series
Elastomers	EPDM (FDA approved)
	Buna Nitrile (FDA approved)
Polymers	NORYL™, NSF Listed
Springs	Stainless steel, 300 series

Features

Sizes: 4", 6", 8", 10"	
Maximum working water pressure	175 PSI
Maximum working water temperature	140°F
Hydrostatic test pressure	350 PSI
End connections	(Grooved for steel pipe) (Flanged)
	AWWA C606-87 ANSI B16.1 Class 125



Certified to
NSF/ANSI 61-G

Options

(Suffixes can be combined)


- | | |
|--------------------------|--|
| <input type="checkbox"/> | - with NRS shut-off valves (standard) |
| <input type="checkbox"/> | FSC - with epoxy coated wye type strainer (flanged only) |
| <input type="checkbox"/> | G - with groove end gate valves |
| <input type="checkbox"/> | FG - with flanged inlet gate connection and grooved outlet gate connection |
| <input type="checkbox"/> | L - less shut-off valves (grooved body connections) |
| <input type="checkbox"/> | MS - with Integral Relief Valve Monitor Switch |
| <input type="checkbox"/> | OSY - with OS & Y gate valves |
| <input type="checkbox"/> | V - vertical flow up configuration |
| <input type="checkbox"/> | BGVIC - with grooved end butterfly valves with integral supervisory switches |
| <input type="checkbox"/> | PI - with Post Indicator Gate Valve (3"-10") |

Accessories

- | | |
|--------------------------|---|
| <input type="checkbox"/> | Air gap (see spec sheet BF-AG) |
| <input type="checkbox"/> | Repair kit (rubber only) |
| <input type="checkbox"/> | Thermal expansion tank (Model XT) |
| <input type="checkbox"/> | Valve setter (Model FLS or MJS or MJFS) |
| <input type="checkbox"/> | Gate valve tamper switch (OSY-40) |
| <input type="checkbox"/> | Electronic Solenoid Timer (Model EST) |
| <input type="checkbox"/> | QT-SET Quick Test Fitting Set |

Relief Valve discharge port:


2 1/2" - 6"	2.75 sq. in.
8" - 10"	3.69 sq. in.

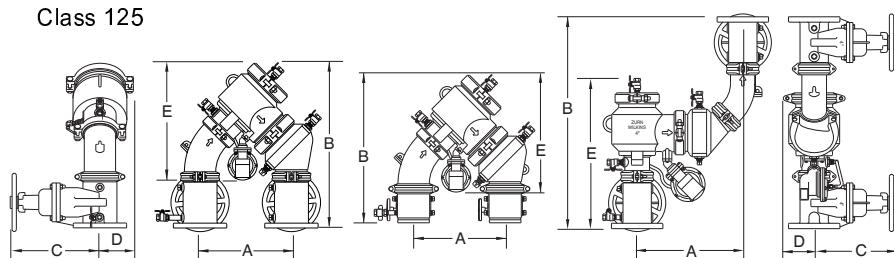


Dimensions & Weights (do not include pkg.)

MDL 475& 475V SIZE	DIMENSION (approximate)												WEIGHT															
	A		B WITH GATE VALVES		B WITH BUTTERFLY VALVES		B LESS GATE VALVES		C OS&Y OPEN		C OS&Y CLOSED		C NRS GATES		C WITH BUTTERFLY VALVES		D		E		E WITH BUTTERFLY VALVES		NRS GATE VALVES		OS&Y GATE VALVES		BTTRFLY. VALVES	
in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	lbs.	kg	lbs.	kg	lbs.	kg	
4" 475	18 5/16	465	30	762	27 5/8	702	21	533	22 3/4	578	18 1/4	464	14 3/4	375	9 1/8	232	5	127	23 1/4	591	23 1/4	591	277	126	287	130	129	59
475V	18 15/16	481	36 1/2	907	31 3/4	807	18 1/2	470	22 3/4	578	18 1/4	464	14 3/4	375	9 1/8	232	5	127	21	533	18 5/8	473	277	126	287	130	129	59
6" 475	18 11/16	475	35 1/2	902	32	813	25	635	30 1/8	765	23 3/4	603	19	483	10 1/8	257	6	152	26	660	26	660	455	207	471	214	223	101
475V	21	533	42	1607	35	889	21	533	30 1/8	765	23 3/4	603	19	483	10 1/8	257	6	152	22	559	18 1/2	470	455	204	471	214	223	101
8" 475	29	737	46	1168	42 7/16	1078	34 7/16	875	37 3/4	959	29 1/4	743	22 1/2	572	11 15/16	303	10	254	33 1/4	845	33 1/4	845	857	389	881	400	513	233
475V	29	737	53 1/2	1359	46 5/16	1176	30 5/16	770	37 3/4	959	29 1/4	743	22 1/2	572	11 15/16	303	10	254	37 7/8	962	34 3/8	873	857	389	881	400	513	233
10" 475	29	737	47 1/2	1207	44 7/16	1129	34 7/16	875	45 3/4	1162	35 3/8	899	26 1/2	673	13 5/16	338	10	254	33 1/4	845	33 1/4	845	1051	477	1097	498	595	270
475V	30 5/16	770	56 1/2	1435	50 5/16	1278	30 5/16	770	45 3/4	1162	35 3/8	899	26 1/2	673	13 5/16	338	10	254	39 3/8	1000	34 3/8	873	1051	477	1097	498	595	270

MODEL 475 & 475V 4" & 6" (STANDARD & METRIC)

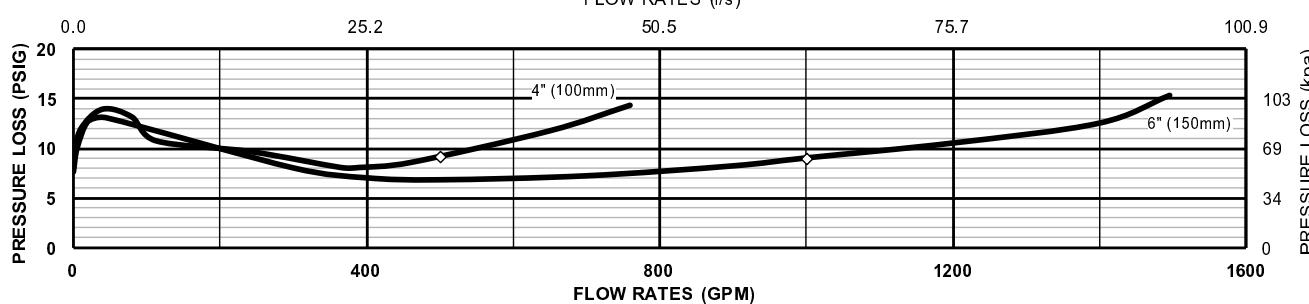

MODEL 475 & 475V 8" & 10" (STANDARD & METRIC)

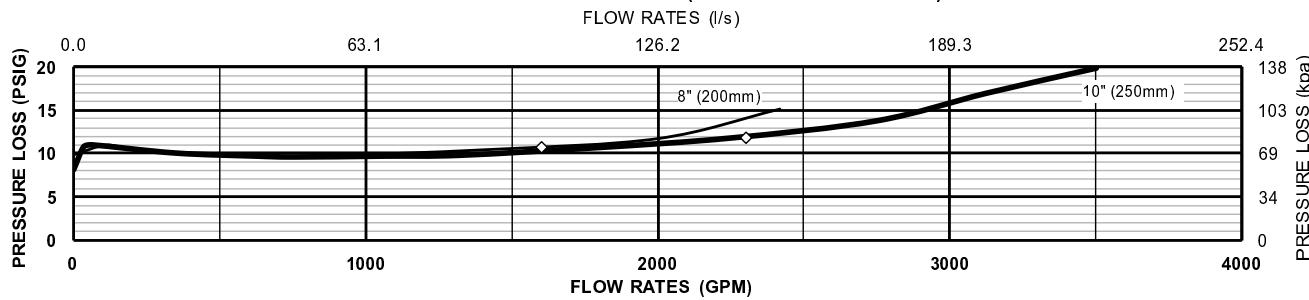


Typical Installation



Local codes shall govern installation requirements. To be installed in accordance with the manufacturers' instructions and the latest edition of the Uniform Plumbing Code. Unless otherwise specified, the assembly shall be mounted above adequate drains with sufficient side clearance for testing and maintenance. The installation shall be made so that no part of the unit can be submerged.

Capacity thru Schedule 40 Pipe (GPM)				
Pipe size	5 ft/sec	7.5 ft/sec	10 ft/sec	15 ft/sec
2 1/2"	75	112	149	224
3"	115	173	230	346
4"	198	298	397	595
6"	450	675	900	1351
8"	780	1169	1559	2339
10"	1229	1843	2458	3687
12"	1763	2644	3525	5288

MODEL SIZE	DIMENSIONS (approx.)				
	A1 SETTER END TO END FLS		A1 SETTER END TO END MJS		
in.	mm	in.	mm	in.	mm
4	100	31 5/16	795	29.313	745
6	150	34 3/4	884	32.75	832
8	200	47	1194	44.625	1133
10	250	51	1295	47	1194

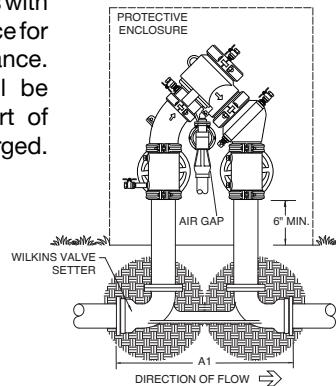

OUTDOOR INSTALLATION

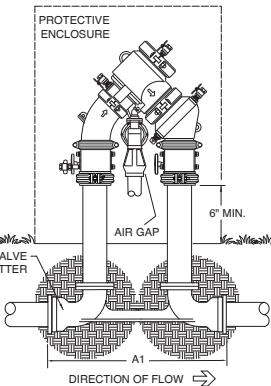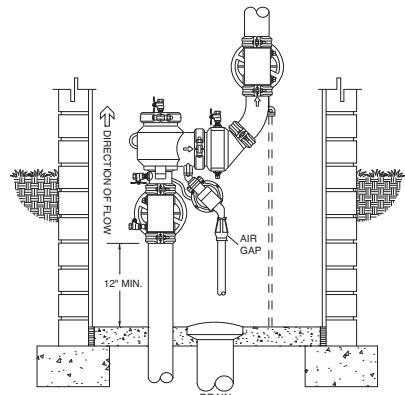OUTDOOR INSTALLATION
475 (with BGVIC valves)

VERTICAL INSTALLATION

Specifications

The Reduced Pressure Principle Backflow Preventer shall be ASSE® Listed 1013, and supplied with full port gate valves. The main body and access covers shall be epoxy coated ductile iron (ASTM A 536 Grade 4), the seat ring and check valve shall be NORYL™, the stem shall be stainless steel (ASTM A 276) and the seat disc elastomers shall be EPDM. Center stem guided design shall incorporate two torsion springs to bias the check in the closed position. The first and second checks shall be accessible for maintenance without removing the relief valve or the entire device from the line. If installed indoors, the installation shall be supplied with an air gap adapter. The Reduced Pressure Principle Backflow Preventer shall be a ZURN WILKINS Model 475 or 475V.

Zurn Industries, LLC | Wilkins

1747 Commerce Way, Paso Robles, CA U.S.A. 93446 Ph. 855-663-9876, Fax 805-238-5766

In Canada | Zurn Industries Limited

3544 Nashua Drive, Mississauga, Ontario L4V 1L2 Ph. 905-405-8272, Fax 905-405-1292

www.zurn.com