



## TECHNICAL DATA

### INSTITUTIONAL QUICK RESPONSE/QREC FLUSH PENDENT SPRINKLER VK410 (K5.6)

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058  
 Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com  
 Visit the Viking website for the latest edition of this technical data page [www.vikinggroupinc.com](http://www.vikinggroupinc.com)


## 1. PRODUCT DESCRIPTION

Viking Institutional Style Quick Response Standard Coverage/Extended Coverage Flush Pendent Sprinklers are small, flush, solder link and lever sprinklers made with tamper-resistant construction. Viking institutional sprinklers have been specifically designed for use with concealed piping in institutional mental health occupancies, correctional facilities, or anywhere a likelihood of tampering with fire sprinklers by the occupants may exist.

The institutional sprinkler assembly consists of the sprinkler body, lockring, and a 3-1/4" (82.6 mm) diameter thread-on escutcheon plate. The sprinkler and escutcheon plate have a polished chrome finish.

Tests simulating conditions of misuse demonstrate the fusible element assembly consistently breaks away when connected to a 30 lb. (13.6 kg) weight dropped 6" (152 mm)†. The Electroless Nickel PTFE (ENT) coating has been investigated for installation in corrosive environments and is listed and approved as indicated in the Approval Charts.

† For a copy of the break-a-way test described, contact The Viking Corporation. The Viking Corporation disclaims any responsibility for damages or injury (including death) caused by the operation or inoperation of sprinklers arising out of the misuse of or tampering with Viking® brand sprinklers including, without limitation, any personal injury or death arising out of or caused by the manipulation of, dismantling of, or attempted use of the sprinkler or any component as an instrument unrelated to its intended use.

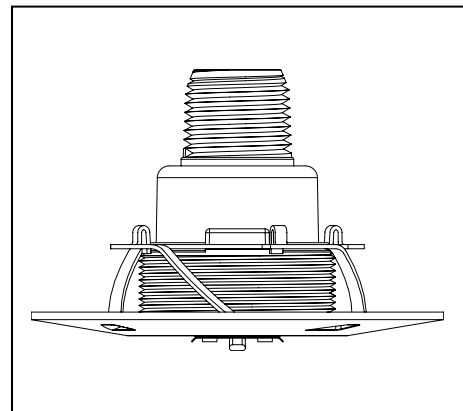

**WARNING:** Cancer and Reproductive Harm-  
[www.P65Warnings.ca.gov](http://www.P65Warnings.ca.gov)

## 2. LISTINGS AND APPROVALS



**cULus Listed:** Category VNIV

**NYC Approved:** MEA 89-92-E, Volume 16

cULus Listed as Quick Response Flush Pendent Sprinkler for standard areas of coverage in Light or Ordinary Hazard occupancies. Also cULus Listed for extended areas of coverage up to 16' x 16' (4.9 m x 4.9 m) in Light Hazard occupancies only. Refer to the Approval Chart on page 3 and Design Criteria on page 4 for cULus Listing requirements that must be followed.

## 3. TECHNICAL DATA

### Specifications:

Maximum Working Pressure: 175 psi (12 bar)

Thread size: 1/2" (15 mm) NPT

Nominal K-Factor: 5.6 U.S. (80.6 metric\*)

\* Metric K-factor measurement is shown in Bar. When pressure is measured in kPa, divide the metric K-factor shown by 10.0.

Overall Length: 2-9/32" (57.9 mm)

### Material Standards:

Sprinkler Body: Brass Casting UNS-C84400

Body Cap: Stainless Steel UNS-S30400 or UNS-S30500

Deflector: Copper UNS-C19500

Deflector Pins: Stainless Steel UNS-S30300

Button: UNS-C23000 H55-H80

Compression Screw: Brass UNS-C36000

Fusible Link Assembly: Beryllium Nickel and Eutectic Solder

Fusible Link Levers: Stainless Steel UNS-S31600

Lever Bar: Copper Alloy UNS-C72500

Belleville Spring Sealing Assembly: Nickel Alloy, coated on both sides with PTFE Tape

### Escutcheon Materials:

Escutcheon Plate: Brass UNS-C26000

Lockring: Stainless Steel UNS-S41000

**Available Finishes And Temperature Ratings:** Refer to Table 1.

**Ordering Instructions:** (Also refer to the current Viking price list.)



## TECHNICAL DATA

### INSTITUTIONAL QUICK RESPONSE/QREC FLUSH PENDENT SPRINKLER VK410 (K5.6)

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058

Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com  
Visit the Viking website for the latest edition of this technical data page [www.vikinggroupinc.com](http://www.vikinggroupinc.com)

**Sprinkler:** Base Part No. 10554

Order Sprinkler VK410 by first adding the appropriate suffix for the sprinkler finish and then the appropriate suffix for the temperature rating to the sprinkler base part number.

Finish Suffixes: Polished Chrome = F and ENT = JN

Temperature Suffix: 165 °F (74 °C) = C, 220 °F (104 °C) = F

For example, sprinkler VK410 with a 165 °F (74 °C) temperature rating = Part No. 10554FC.

Escutcheon Packages: Part No. 10627F for Chrome or 10627JN for ENT (each includes lockring and escutcheon plate).

**Accessories:** (Also refer to the Viking website.)

**Sprinkler Wrenches\*:**

A. Heavy Duty Part Number 08336W/B Available since 1983, or

B. Light Duty Part Number 10366W/B\*\* Available since 1998.

\*Requires a 1/2" ratchet (not available from Viking).

\*\*Ideal for sprinkler cabinets.

**Institutional Escutcheon Installation Wrench:** Part No. 10551W/B (available since 1999)

**Spanner Wrench:** Part No. 10729\*\*\* (for removal of institutional escutcheon plate), 2-1/2" C-C (available since 1999)

\*\*\*For removal of the Institutional Quick Response Flush Pendent Sprinklers, special tools are needed (not all the required tools are available from Viking). Refer to section 6. INSPECTIONS, TESTS, AND MAINTENANCE, paragraph D. on pages 7-8.

**Sprinkler Cabinet:**

Six-head capacity: Part No. 01731A (available since 1971)

**Retaining Flange Assembly:** Part No. 10599, includes: Retaining Flange Casting: AISI C1045 Low Carbon Steel (available since 1999)

Thickness: 13/32" (10.3 mm)

Outside Diameter: 2-3/4" (70 mm)

Socket Set Screw††: Steel Alloy

††Requires a 1/8" hex wrench for installation and removal (not available from Viking).

## 4. INSTALLATION

**TABLE 1: AVAILABLE SPRINKLER TEMPERATURE RATINGS AND FINISHES**

Sprinkler Temperature Classification	Sprinkler Nominal Temperature Rating <sup>1</sup>	Maximum Ambient Ceiling Temperature <sup>2</sup>
Ordinary	165 °F (74 °C)	100 °F (38 °C)
Intermediate	220 °F (104 °C)	150 °F (65 °C)

**Sprinkler Finish:** Polished Chrome, ENT<sup>3,4</sup>

### Footnotes

<sup>1</sup> The sprinkler temperature rating is stamped on the sprinkler.

<sup>2</sup> Based on NFPA-13. Other limits may apply, depending on fire loading, sprinkler location, and other requirements of the Authority Having Jurisdiction. Refer to specific installation standards.

<sup>3</sup> cULus Listed as corrosion resistant.

<sup>4</sup> The corrosion resistant and corrosion proofing coatings have passed the standard corrosion test required by the approving agencies indicated in the Approval Chart. These tests cannot and do not represent all possible corrosive environments. Prior to installation, verify through the end-user that the coatings are compatible with or suitable for the proposed environment. For automatic sprinklers, the ENT coating is applied to all exposed exterior surfaces, including the waterway. Note that the spring is exposed on sprinklers with PTFE coatings.



## TECHNICAL DATA

## INSTITUTIONAL QUICK RESPONSE/QREC FLUSH PENDENT SPRINKLER VK410 (K5.6)

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058  
 Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com  
 Visit the Viking website for the latest edition of this technical data page [www.vikinggroupinc.com](http://www.vikinggroupinc.com)

### Approval Chart

Institutional Style Quick Response Flush Pendent Sprinkler SIN VK410  
 Maximum 175 PSI (12 bar) WWP

	Temperature	KEY
↓	Finish	
↓	A1X ←	Escutcheon (if applicable)

Sprinkler Base Part Number <sup>1</sup>	NPT Thread Size		Nominal K-Factor		Overall Length		Listings and Approvals <sup>3</sup> (Refer also to Design Criteria on page 4.)						
	Inches	mm	U.S.	metric <sup>2</sup>	Inches	mm	cULus <sup>4</sup>	FM	NYC <sup>6</sup>	VdS	LPCB	CE	UL
10554	1/2	15	5.6	80.6	2-9/32	57.9							
Standard Coverage Applications - For Light and Ordinary Hazard Occupancies							A1, A2	--	B1	--	--	--	--
<u>Extended Coverage Applications</u> - For Light Hazard Occupancies Only							cULus <sup>5</sup>	FM	NYC	VdS	LPCB	CE	UL
Maximum Area of Coverage: 16' x 16' (4.9 m x 4.9 m)													
Minimum Water Supply Requirements: 26 gpm @ 21.6 psi (98.4 L/min @ 1.49 bar)							A1, A2	--	See Footnote 7.	--	--	--	--
Approved Temperature Ratings A - 165 °F (74 °C) and 220 °F (104 °C) B - 165 °F (74 °C)							Approved Finish 1 - Polished Chrome 2 - ENT <sup>8</sup>						

### Footnotes

- <sup>1</sup> Part number shown is the base part number. For complete part number, refer to current Viking price list schedule.
- <sup>2</sup> Metric K-factor measurement shown is when pressure is measured in Bar. When pressure is measured in kPa, divide the metric K-factor shown by 10.0.
- <sup>3</sup> This chart shows the listings and approvals available at the time of printing. Other approvals may be in process. Check with the manufacturer for any additional approvals.
- <sup>4</sup> Listed by Underwriter's Laboratories for use in the U.S. and Canada as a Quick Response Flush Pendent Sprinkler for standard areas of coverage.
- <sup>5</sup> Listed by Underwriter's Laboratories for use in the U.S. and Canada as a Quick Response Extended Coverage Flush Pendent Sprinkler for Light Hazard occupancies only.
- <sup>6</sup> Accepted for use, City of New York Department of Buildings, MEA Number 89-92-E, Vol. 16.
- <sup>7</sup> Meets New York City requirements, effective July 1, 2008.
- <sup>8</sup> cULus Listed as corrosion resistant.

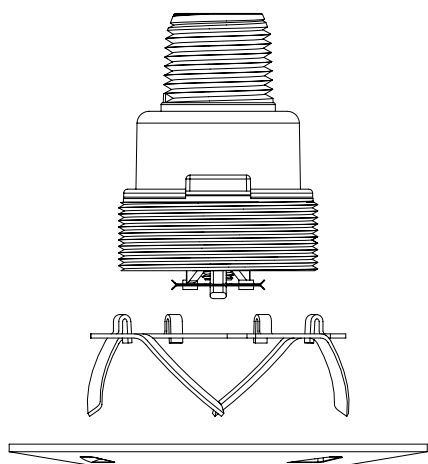


Figure 1: Sprinkler Body, Lockring, and Escutcheon Plate

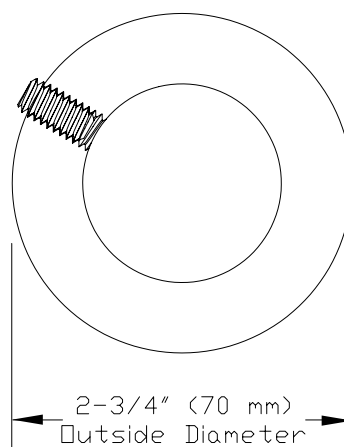


Figure 2: Retaining Flange



## TECHNICAL DATA

### INSTITUTIONAL QUICK RESPONSE/QREC FLUSH PENDENT SPRINKLER VK410 (K5.6)

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058  
 Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com  
 Visit the Viking website for the latest edition of this technical data page [www.vikinggroupinc.com](http://www.vikinggroupinc.com)

#### DESIGN CRITERIA

(Also refer to the Approval Chart on page 3)

##### cULus Listing Requirements for Standard Coverage Applications:

Sprinkler VK410 is cULus Listed as a Quick Response Flush Pendent Sprinkler for standard areas of coverage as indicated in the Approval Chart for installation in accordance with the latest edition of NFPA 13.

- Designed for use in Light and Ordinary Hazard occupancies.
- The sprinkler must be installed in the pendent position in fixed fire protection systems (wet, dry, deluge, or preaction systems).
- Protection areas and maximum spacing shall be in accordance with the tables provided in NFPA 13.
- Minimum spacing allowed is 6 ft. (1.8 m) unless baffles are installed in accordance with NFPA 13.
- Minimum distance from walls is 4 in. (102 mm).
- Maximum distance from walls shall be no more than one-half of the allowable distance between sprinklers. The distance shall be measured perpendicular to the wall.
- The sprinkler installation and obstruction rules contained in NFPA 13 for standard coverage spray pendent sprinklers must be followed.

##### cULus Listing Requirements for Extended Coverage Applications:

Sprinkler VK410 is cULus Listed as a Quick Response Extended Coverage Flush Pendent Sprinkler as indicated in the Approval Chart for installation in accordance with the latest edition of NFPA 13 for extended coverage pendent spray sprinklers.

- Designed for use in Light Hazard occupancies only.
- The sprinkler must be installed in the pendent position in fixed fire protection systems (wet, dry, deluge, or preaction systems).
- Minimum distance from walls is 4 in. (102 mm).
- Maximum distance from walls shall be no more than one-half of the allowable distance between sprinklers. The distance shall be measured perpendicular to the wall.
- The sprinkler installation and obstruction rules contained in NFPA 13 for extended coverage pendent spray sprinklers must be followed.

**IMPORTANT: Always refer to Bulletin Form No. F\_091699 - Care and Handling of Sprinklers. Also refer to page F\_080614 for general care, installation, and maintenance information. Viking sprinklers are to be installed in accordance with the latest edition of Viking technical data, the appropriate standards of NFPA, FM Global, LPCB, APSAD, VdS or other similar organizations, and also with the provisions of governmental codes, ordinances, and standards, whenever applicable.**

(Refer to Figures 1-4.)

**WARNING:** Viking sprinklers are manufactured and tested to meet the rigid requirements of the approving agency. The sprinklers are designed to be installed in accordance with recognized installation standards. Deviation from the standards or any alteration to the sprinkler after it leaves the factory including, but not limited to: painting, plating, coating, or modification, may render the sprinkler inoperative and will automatically nullify the approval and any guarantee made by The Viking Corporation. Flush sprinklers are decorative sprinklers and may be considered special purpose. As such, some Authorities may limit the use depending on the occupancy classification. Refer to the Authority Having Jurisdiction prior to installation.


- A. Sprinklers must be handled with care. They must be stored in a cool, dry place in their original shipping container. Never install sprinklers that have been dropped, damaged in any way, or exposed to temperatures in excess of maximum ambient temperature allowed. Such sprinklers should be destroyed immediately.
- B. Viking Institutional Quick Response Flush Pendent Sprinklers are not intended for use in corrosive environments. Use only sprinklers listed for corrosive environments when subject to corrosive atmospheres.
- C. Use care when locating sprinklers near fixtures that can generate heat. Do not install sprinklers where they will be exposed to temperatures that exceed the maximum recommended ambient temperature for the temperature rating used.
- D. Adequate heat must be provided when the Institutional Quick Response Flush Pendent Sprinkler is installed on wet-pipe systems.
- E. The sprinklers must be installed after the piping is in place to prevent mechanical damage. Before installing, be sure to have the appropriate sprinkler model and style, with the correct orifice size, temperature rating, and response characteristics. Install the sprinklers according to the following sequence:
  1. Install all piping and cut the sprinkler drop nipple so that the 1/2" (15 mm) NPT outlet of the reducing coupling is at the desired elevation and centered in a 2-1/4" (57.2 mm) diameter opening in the ceiling (due to locking). Note: If the retaining flange assembly is to be used, slide the flange over the sprinkler drop nipple prior to threading the nipple into the branch line tee as shown in Figure 4-A.
  2. The internal diameter of the special Flush/Concealed Sprinkler Wrench is designed for use with the sprinkler contained in the protective plastic shell. With the sprinkler in the shell, apply a small amount of pipe-joint compound or tape to the external threads of the sprinkler only, taking care not to allow a build-up of compound in the sprinkler inlet.
  3. Refer to Figure 4-B and use only Sprinkler Wrench 08336W/B or 10366W/B, which is designed for installing Viking Institutional Quick Response Flush Pendent Sprinklers. With the sprinkler in the plastic protective shell, place the unit into the wrench. DO NOT use the fusible link to start or thread the sprinkler into a fitting. Turn the unit clockwise to thread the sprinkler into the coupling, taking care not to over-tighten or damage the sprinkler operating parts.



## TECHNICAL DATA

### INSTITUTIONAL QUICK RESPONSE/QREC FLUSH PENDENT SPRINKLER VK410 (K5.6)

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058  
 Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com  
 Visit the Viking website for the latest edition of this technical data page [www.vikinggroupinc.com](http://www.vikinggroupinc.com)

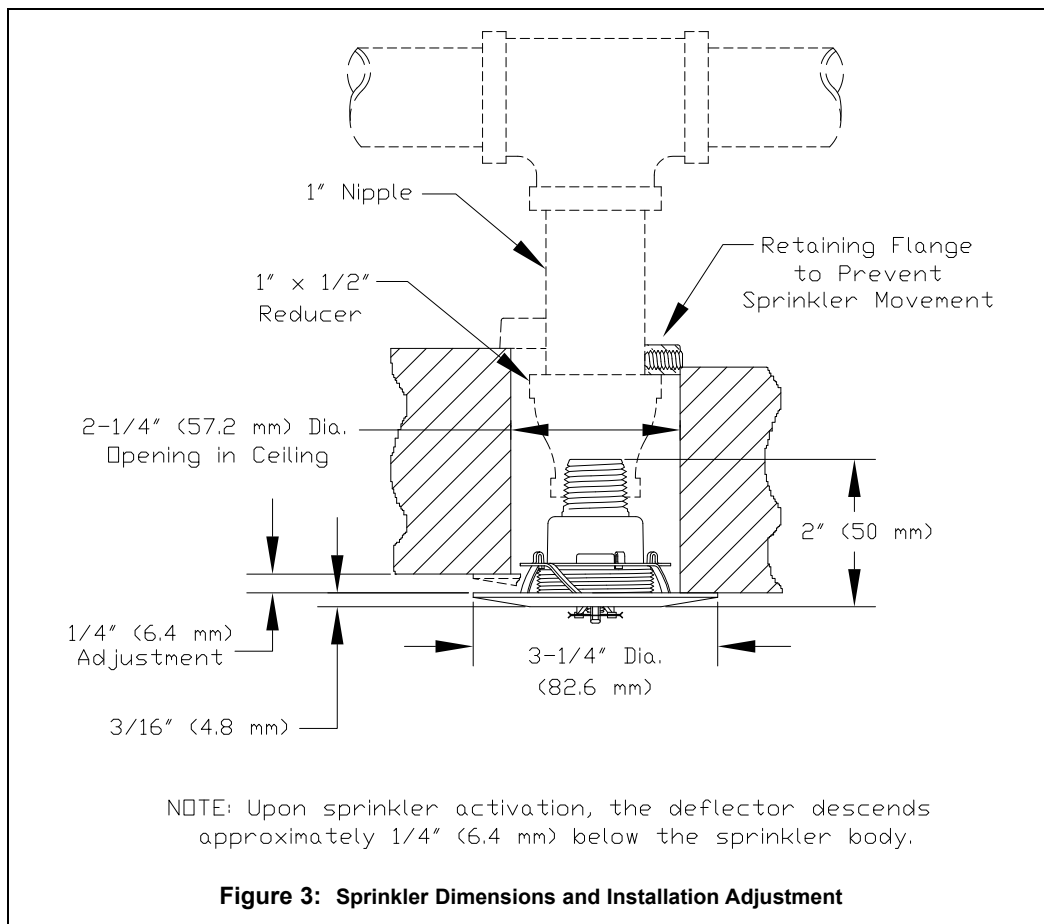

F. After installation, the entire system must be tested in accordance with recognized installation standards. The test is applied after sprinkler installation to ensure that no damage has occurred to the sprinkler during shipping and installation, and to make sure the unit has been properly tightened. If a thread leak occurs, normally the unit must be removed, new pipe-joint compound or tape applied, and then reinstalled. This is due to the fact that when the joint seal leaks, the sealing compound or tape is washed out of the joint.

G. After testing, repairing all leaks, and installing and painting the ceiling, remove the plastic protective shell from the sprinkler.

**INSTALLATION TIP:** Prior to installing the locking, temporarily install the escutcheon (without locking) onto the sprinkler to verify that the sprinkler supply nipple is of the proper length and the desired sprinkler and escutcheon position has been achieved. If necessary, re-cut the sprinkler supply nipple and repeat the process. When satisfied with the length of the sprinkler supply nipple and final position of the sprinkler and escutcheon, remove the escutcheon, install the locking, and use the escutcheon installation wrench to re-install the escutcheon.

Do NOT install the locking onto the sprinkler until after the sprinkler nipple has been cut back to ensure the sprinkler is at the desired elevation in relation to the face of the ceiling. The locking will prove difficult to remove from the sprinkler once it has been installed above the plane of the ceiling. Check final installation by temporarily installing the escutcheon plate onto the sprinkler without the locking, using Institutional Escutcheon Installation Wrench 10551W/B. If necessary, re-cut the sprinkler nipple as required. Once satisfied with sprinkler level compared to the surface of the ceiling, install locking and escutcheon plate following the steps below. The escutcheon plate cannot be removed after it has been installed with the locking, so do not install the escutcheon plate with the locking until after the system has been tested.


H. As shown in Figure 4-C and D, fit the locking over the open end of the protective sprinkler shell and use the shell to gently press the locking over the threads of the sprinkler. The ring must rest against the two wrench ears of the sprinkler body with the four arms of the locking pointing outward.



## TECHNICAL DATA

### INSTITUTIONAL QUICK RESPONSE/QREC FLUSH PENDENT SPRINKLER VK410 (K5.6)

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058  
 Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com  
 Visit the Viking website for the latest edition of this technical data page [www.vikinggroupinc.com](http://www.vikinggroupinc.com)

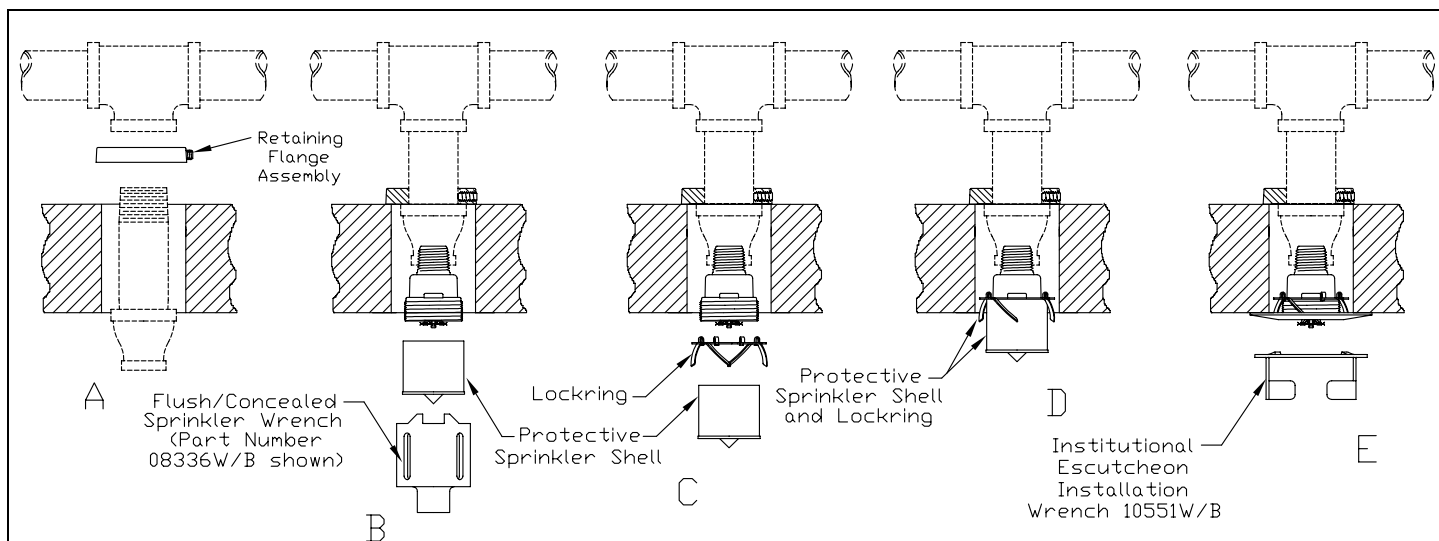

#### INSTALLATION TIP:

Do not install the locking onto the sprinkler until after the sprinkler nipple has been cut back to ensure the sprinkler is at the desired elevation in relation to the face of the ceiling. The locking will prove difficult to remove from the sprinkler once it has been installed above the plane of the ceiling. Check final installation by temporarily installing the escutcheon plate onto the sprinkler without the locking, using the Institutional Escutcheon Installation Wrench. If necessary, re-cut the sprinkler drop nipple as required.

Once satisfied with sprinkler level compared to the surface of the ceiling, install locking and escutcheon plate following steps H through J below. The escutcheon plate cannot be removed after it has been installed with the locking, so do not install the escutcheon plate with the locking until after the system has been tested.

Figure 4: Sequence of Installation

- I. REMOVE THE PLASTIC PROTECTIVE SHELL from the sprinkler. (Recommendation: retain a protective shell in the spare sprinkler cabinet.)
- J. As depicted in Figure 4-E, use the Institutional Escutcheon Installation Wrench to screw on the escutcheon plate clockwise. The face of the escutcheon plate is equipped with four indentations to complement the design of the Institutional Escutcheon Installation Wrench 10551W/B and facilitate installation of the escutcheon plate. As the escutcheon plate is threaded onto the sprinkler body, the four arms of the locking must fully engage with the radial grooves on the inside of the escutcheon plate. Continue to thread the escutcheon plate onto the sprinkler body until the plate's flange fits tightly against the surface of the ceiling. Then, proceed to turn the escutcheon plate another  $\frac{1}{2}$  turn clockwise to ensure that it is secured to the ceiling. The arms of the locking are angled and designed to wedge into the coined radial grooves on the inside face of the escutcheon plate to keep the escutcheon plate from being unscrewed. Thus, an attempt to remove the escutcheon plate after installation is prevented. DO NOT MODIFY THE UNIT.
- K. The retaining flange, located behind the finished ceiling, must fit snug against the inner surface of the ceiling to prevent vertical movement of the assembly. Use a  $\frac{1}{8}$ " hex wrench to tighten the retaining flange screw and secure the assembly into place to prevent it from being pulled through the ceiling.
- L. DISASSEMBLY: Refer to section 6. INSPECTIONS, TESTS AND MAINTENANCE, paragraph D. and follow all warnings and instructions.

## 5. OPERATION

The sprinkler is recessed into the mounting surface, flush to the ceiling, with only a portion of the fusible link assembly exposed beneath the ceiling. The concealed deflector is held inside the sprinkler body until the eutectic metal solder link is fused. When the sprinkler fuses, the deflector extends to discharge and distribute water. The multi-piece design allows the installation and testing of the institutional sprinklers prior to installation of the ceiling.





## TECHNICAL DATA

### INSTITUTIONAL QUICK RESPONSE/QREC FLUSH PENDENT SPRINKLER VK410 (K5.6)

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058  
 Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com  
 Visit the Viking website for the latest edition of this technical data page [www.vikinggroupinc.com](http://www.vikinggroupinc.com)

The special escutcheon plate on the Institutional Quick Response Flush Pendent Sprinkler assembly is the only ceiling ring that may be used with these institutional sprinklers, and all of these sprinklers must be installed with this escutcheon plate. Removal of the thread-on escutcheon plate is prevented by the locking.

The sprinkler pipe above the ceiling leading to the sprinkler must be secured to prevent any movement of the sprinkler. One method of anchoring the pipe above the ceiling is to use the retaining flange and screw assembly that are available from Viking. The flange slides over the sprinkler drop nipple prior to threading the nipple into the branch line tee (see Figure 4-A).

## 6. INSPECTIONS, TESTS AND MAINTENANCE

(Refer to Figures 1-4.)

**NOTICE:** The owner is responsible for maintaining the fire protection system and devices in proper operating condition. For minimum maintenance and inspection requirements, refer to NFPA 25 for Inspection, Testing and Maintenance requirements. In addition, the Authority Having Jurisdiction may have additional maintenance requirements that must be followed.

- A. The sprinklers must be inspected on a regular basis for corrosion, mechanical damage, obstructions, paint, etc. The frequency of inspections may vary due to corrosive atmospheres, water supplies, and activity around the device.
- B. Sprinklers that have been painted or mechanically damaged must be replaced immediately. Sprinklers showing signs of corrosion shall be tested and/or replaced immediately as required. Installation standards require sprinklers to be tested and, if necessary, replaced after a specified term of service. Refer to the installation standards and the Authority Having Jurisdiction for the specified period of time after which testing and/or replacement is required. Sprinklers that have operated cannot be reassembled or reused, but must be replaced. When replacing sprinklers, use only new sprinklers.
- C. The sprinkler discharge pattern is critical for proper fire protection. Nothing should be hung from the sprinkler, attached to it, or otherwise obstruct the discharge pattern. All obstructions must be immediately removed or, if necessary, additional sprinklers installed.
- D. When replacing existing sprinklers, the system must be removed from service. Refer to the appropriate system description and/or valve instructions. Prior to removing the system from service, notify all Authorities Having Jurisdiction. Consideration should be given to employment of a fire patrol in the affected area.

**DISASSEMBLY:** There are two methods of sprinkler disassembly. In Method 1, the escutcheon plate and locking are removed first, and then the remaining sprinkler components can be removed without being destroyed. The second method of disassembly results in complete destruction of the unit.

### Disassembly Method 1:

1. Remove the system from service, drain all water, and relieve all pressure on the piping.
2. Use a drill (not available from Viking) sized appropriately for use with a spanner wrench (see step 3) to make two holes through two opposite indentations on the face of the escutcheon plate.
3. Use a 2-1/2" C-C spanner wrench (Viking Part No. 10729) to unthread the escutcheon plate by turning it counterclockwise. Make sure that the sprinkler body does not turn or loosen.
4. Remove the locking from the sprinkler body.
5. Place a protective sprinkler shell (from the spare sprinkler cabinet) over the sprinkler to be removed.
6. With the protective shell over the sprinkler, place Sprinkler Wrench 08336W/B or 10366W/B over the unit and turn it counterclockwise to carefully unthread the sprinkler body from the reducing coupling.
7. Install the new unit using the sprinkler wrench. Care must be taken to ensure that the replacement sprinkler is the proper model and style, with the appropriate orifice size, temperature rating, and response characteristics. A fully stocked spare sprinkler cabinet should be provided for this purpose. (Stock of spare lockings and escutcheon plates should be available in the spare sprinkler cabinet in addition to the spare sprinkler heads.)
8. Place the system back in service and secure all valves. Check for and repair all leaks.

**NOTE: Disassembly Method 1 results in damage to the escutcheon plate and locking, and they cannot be reused.**

### Disassembly Method 2:

1. Remove the system from service, drain all water, and relieve all pressure on the piping.
2. Disassemble and remove the fusible element, and bend the deflector and sealing assembly to expose the waterway of the sprinkler.
3. Insert an easy-out screw extractor (Trade No. 6) into the waterway. Turn the easy-out counterclockwise with a wrench to remove the sprinkler assembly from the reducing coupling.

**NOTE: Disassembly Method 2 results in complete destruction of the unit. None of the sprinkler components may be reused.**



## TECHNICAL DATA

### INSTITUTIONAL QUICK RESPONSE/QREC FLUSH PENDENT SPRINKLER VK410 (K5.6)

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058  
 Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com  
 Visit the Viking website for the latest edition of this technical data page [www.vikinggroupinc.com](http://www.vikinggroupinc.com)

4. Install the new unit using Sprinkler Wrench 08336W/B or 10366W/B. Care must be taken to ensure that the replacement sprinkler is the proper model and style, with the appropriate orifice size, temperature rating, and response characteristics. A fully stocked spare sprinkler cabinet should be provided for this purpose. (Stock of spare lockrings and escutcheon plates should be available in the spare sprinkler cabinet in addition to the spare sprinkler heads.)
5. Place the system back in service and secure all valves. Check for and repair all leaks.
- E. Sprinkler systems that have been subject to a fire must be returned to service as soon as possible. The entire system must be inspected for damage and repaired or replaced as necessary. Sprinklers that have been exposed to corrosive products of combustion or high ambient temperatures, but have not operated, should be replaced. Refer to the Authority Having Jurisdiction for minimum replacement requirements.

## 7. AVAILABILITY

Viking Sprinkler VK410 is available through a network of domestic and international distributors. See The Viking Corporation web site for the closest distributor or contact The Viking Corporation.

## 8. GUARANTEE

For details of warranty, refer to Viking's current list price schedule or contact Viking directly.

## 9. DISCLAIMER

THE VIKING CORPORATION DISCLAIMS ANY RESPONSIBILITY FOR DAMAGES OR INJURY (INCLUDING DEATH) CAUSED BY THE OPERATION OR INOPERATION OF SPRINKLERS ARISING OUT OF THE MISUSE OF OR TAMPERING WITH VIKING® BRAND SPRINKLERS INCLUDING, WITHOUT LIMITATION, ANY PERSONAL INJURY OR DEATH ARISING OUT OF OR CAUSED BY THE MANIPULATION OF, DISMANTLING OF, OR ATTEMPTED USE OF THE SPRINKLER OR ANY COMPONENT AS AN INSTRUMENT UNRELATED TO ITS INTENDED USE.